



# OLYMPIC VALLEY PUBLIC SERVICE DISTRICT BOARD REPORT




**SUBJECT:** October Water & Sewer Operations Report      **EXHIBIT:** G-2, 5 Pages  
**AUTHOR:** Nicolas Massetani, Operations Superintendent      **MEETING DATE:** November 18, 2025

**RECOMMENDED ACTION:** This report is informational only; no action is requested from the Board.

**DISCUSSION:** This report provides information from the District’s management on current projects and activities that are not the subject of a separate report. This report is prepared to provide new information and recent progress only.


Flow Report – October 2025

Water Production: 6.01 MG  
Comparison: 1.36 MG less than 2024

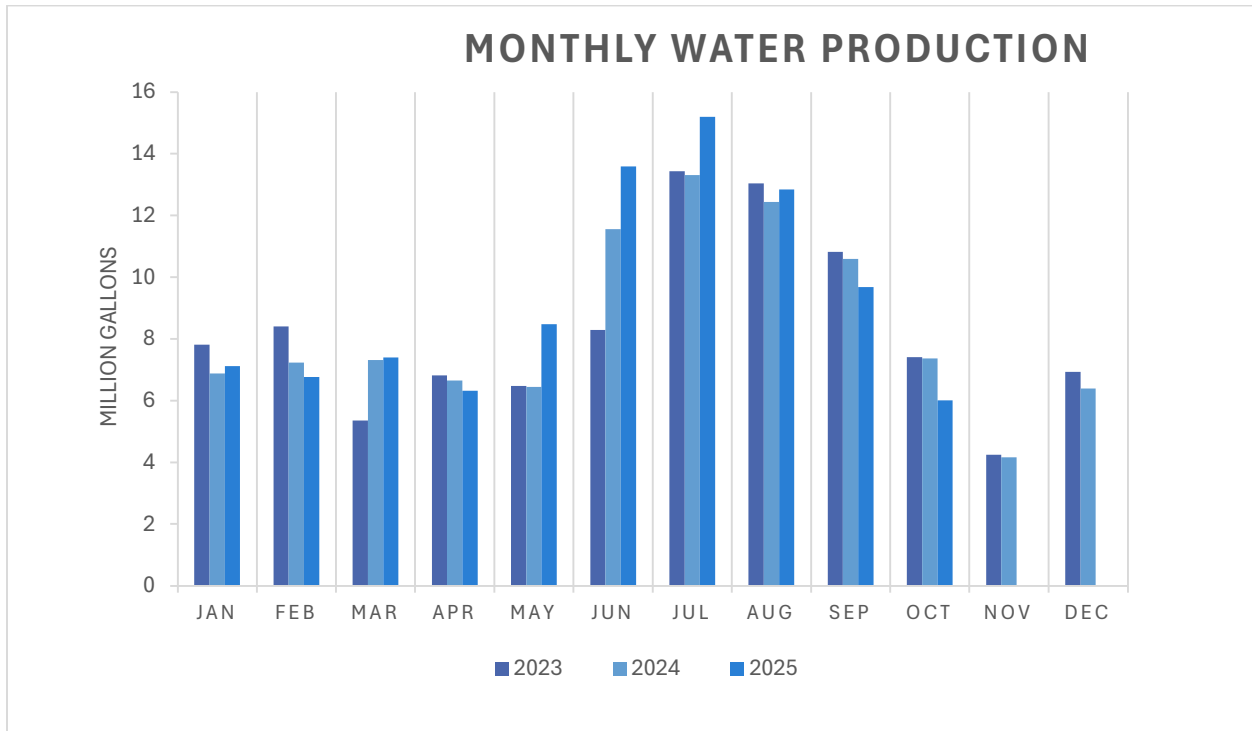

Sewer Collection:  
Comparison:

3.24 MG  
0.23 MG less than 2024

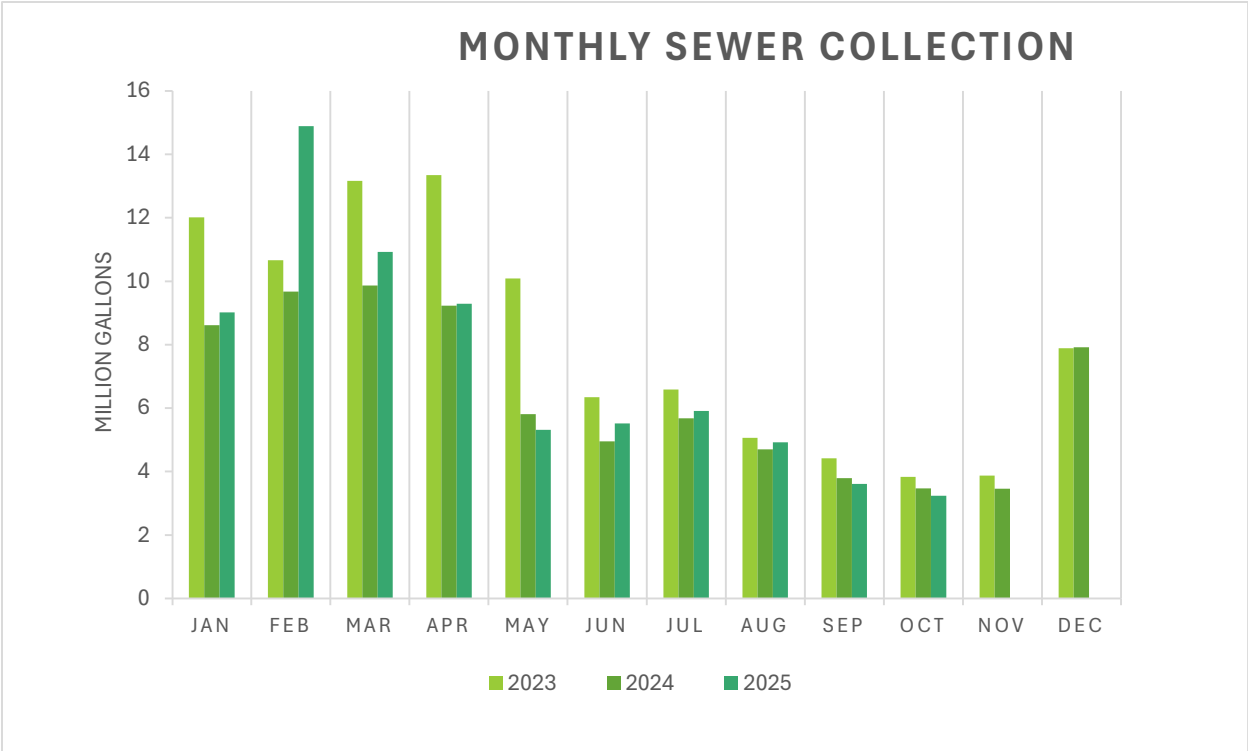

Aquifer Level:            October 31, 2025:            6,186.7'  
    October 31, 2024:            6,181.4'  
    Highest Recorded:            6,192.0'  
    Lowest Recorded:            6,174.0'

Creek Bed Elevation, Well 2:            6,186.9'

Precipitation:            October 2025:            4.01"  
    Season to date total:            4.01"  
    Season to date average:            3.23"  
    % to year to date average:            124.11%

Flow Report Notes:

- The *Highest Recorded Aquifer Level* represents a rough average of the highest levels measured in the aquifer during spring melt period.
- The *Lowest Recorded Aquifer Level* is the lowest level recorded in the aquifer at 6,174.0 feet above mean sea level on October 5, 2001. This level is not necessarily indicative of the total capacity of the aquifer.

- The *Creek Bed Elevation* (per Kenneth Loy, West Yost Associates) near Well 2 is 6,186.9 feet.
- *Precipitation Season Total* is calculated from October 2024 through September 2025.
- The true *Season to date Average* could be higher or lower than the reported value due to the uncertainty of the Old Fire Station precipitation measurement during the period 1994 to 2004.
- In October 2011 the data acquisition point for the aquifer was changed from Well 2 to Well 2R.

### Leaks and Repairs

#### Water

- The District issued zero leak/high usage notifications.
- Responded to one after-hours customer service calls.

#### Sewer

- Responded to zero after-hours customer service calls.

### Vehicles and Equipment

#### Vehicles

- Cleaned vehicles and checked inventory.

#### Equipment

- Cleaned equipment.

### Operations and Maintenance Projects

#### 1810 Olympic Valley Road (Old Fire Station)

- Inspected and tested the generator.
- General housekeeping.

#### 305 Olympic Valley Road (Administration and Fire Station Building)

- Inspected and tested the generator.

#### Water System Maintenance

- Three bacteriological tests were taken in September: one at 1810 Olympic Valley Road, one at Everline Resort and one at Zone 3 Booster Station; All three samples were reported absent.
- Leak detection services performed: Zero.
- Customer service turn water service on: Zero.
- Customer service turn water service off: Zero.
- Responded to customer service calls with no water: One
- Water meter upgrades: seven

#### Sewer System Maintenance

- Check for I and I issues.
- Sewer cleaning.

#### Telemetry

- The rainfall measurements for the month of August were as follows:  
Nova Lynx: 4.01", Palisades Tahoe Snotel: 5.3".

#### Administration

- Monthly California State Water Boards report.

#### Services Rendered

- Underground Service Alerts (20)
- Sewer service line inspections (4)
- Sewer service line pressure tests (2)
- Water service line inspections (4)
- Water quality complaint investigations (12)\*

\*All issues are related to the water main break on Tiger Tail and the resulting turbidity caused by high water flow velocity.

#### Other Items of Interest

- Repaired damaged water main connecting Tiger Tail to Shoshone.
- Repaired damaged 224 Tiger Tail corporation stop valve.
- Commercial meter installations continue.
- Quarterly Preventative Maintenance inspections complete.

**ATTACHMENTS:** Monthly Water Audit Report

**DATE PREPARED:** November 7, 2025

## Olympic Valley Public Service District - Monthly Water Audit Report

Audit Month: October      Report Date: November 7, 2025      Performed By: Nic Massetani  
 Year: 2025  
 Meter Reader: Ben Procida      Reading begin Date & Time: 10/29/25 9:00 AM  
    Reading end Date & Time: 10/29/25 12:00 PM  
    Total lag time: 3:00:00  
 Begin Audit Period: 10/1/25 12:00 AM  
 End Audit Period: 10/29/25 12:00 AM

Total Metered Consumption for audit period specified (including hydrant meters): 4,185,799

Additional Consumption - Unmetered

Fire Department Use: 5,000  
 Hydrant Flushing: 150,000  
 Blow-Off Flushing: \_\_\_\_\_  
 Sewer Cleaning: 8,400  
 Street Cleaning: \_\_\_\_\_  
 Well Flushing: \_\_\_\_\_  
 Tank Overflows: \_\_\_\_\_  
 Unread Meter Estimated Reads: 182,320  
 Other: \_\_\_\_\_  
 Total Unmetered Consumption (for audit period specified): 345,720

Estimated Unknown Loss - Unmetered

Known Theft: \_\_\_\_\_  
 Known Illegal Connections: \_\_\_\_\_  
 Total Estimated leaks that have been repaired: 120,620  
 Total Estimated Unmetered (for audit period specified): 120,620

Total Production for audit period specified: 5,617,941

Total Metered/Unmetered Consumption for audit period specified: 4,652,139

**Total Water Loss (Production - Consumption): 965,802**

**Comments:** The production totals are different than the monthly report due to a different time frame being used.  
 The District continues to investigate leaks.

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\* Note - All Production & Consumption Totals In U.S. Gallons \*