



# OLYMPIC VALLEY PUBLIC SERVICE DISTRICT BOARD REPORT




**SUBJECT:** December Water & Sewer Operations Report      **EXHIBIT:** G-2, 5 Pages  
**AUTHOR:** Nicolas Massetani, Operations Superintendent      **MEETING DATE:** January 27, 2026

**RECOMMENDED ACTION:** This report is informational only; no action is requested from the Board.

**DISCUSSION:** This report provides information from the District’s management on current projects and activities that are not the subject of a separate report. This report is prepared to provide new information and recent progress only.


Flow Report – December 2025

Water Production: 6.20 MG  
Comparison: 0.19 MG less than 2024

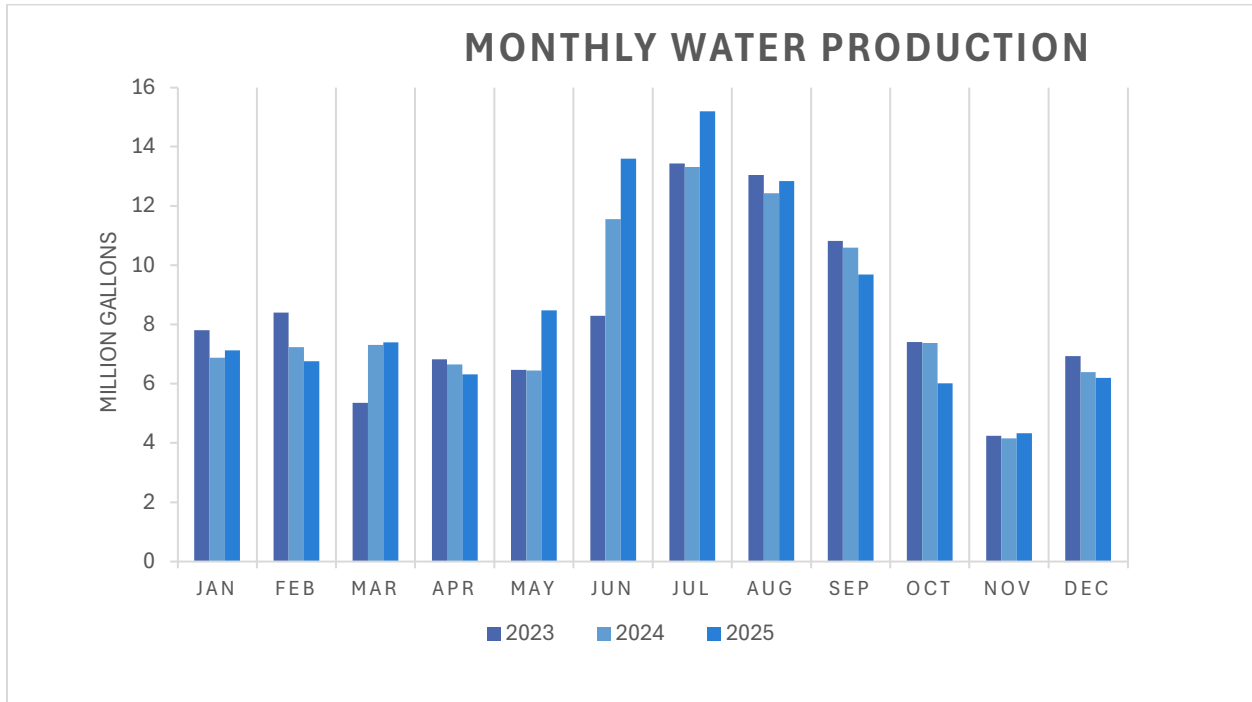

Sewer Collection:  
Comparison:


9.27 MG  
1.35 MG more than 2024

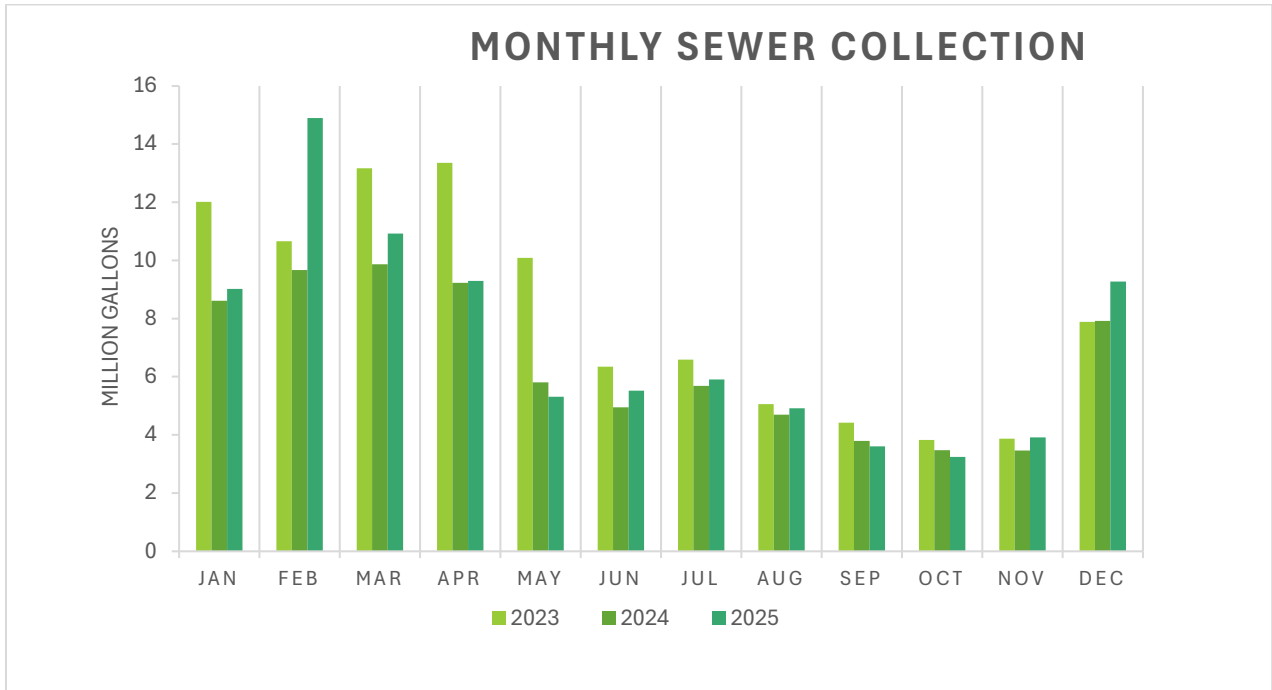

Aquifer Level:

December 31, 2025:  
December 31, 2024:

6,188.6'  
6,188.2'

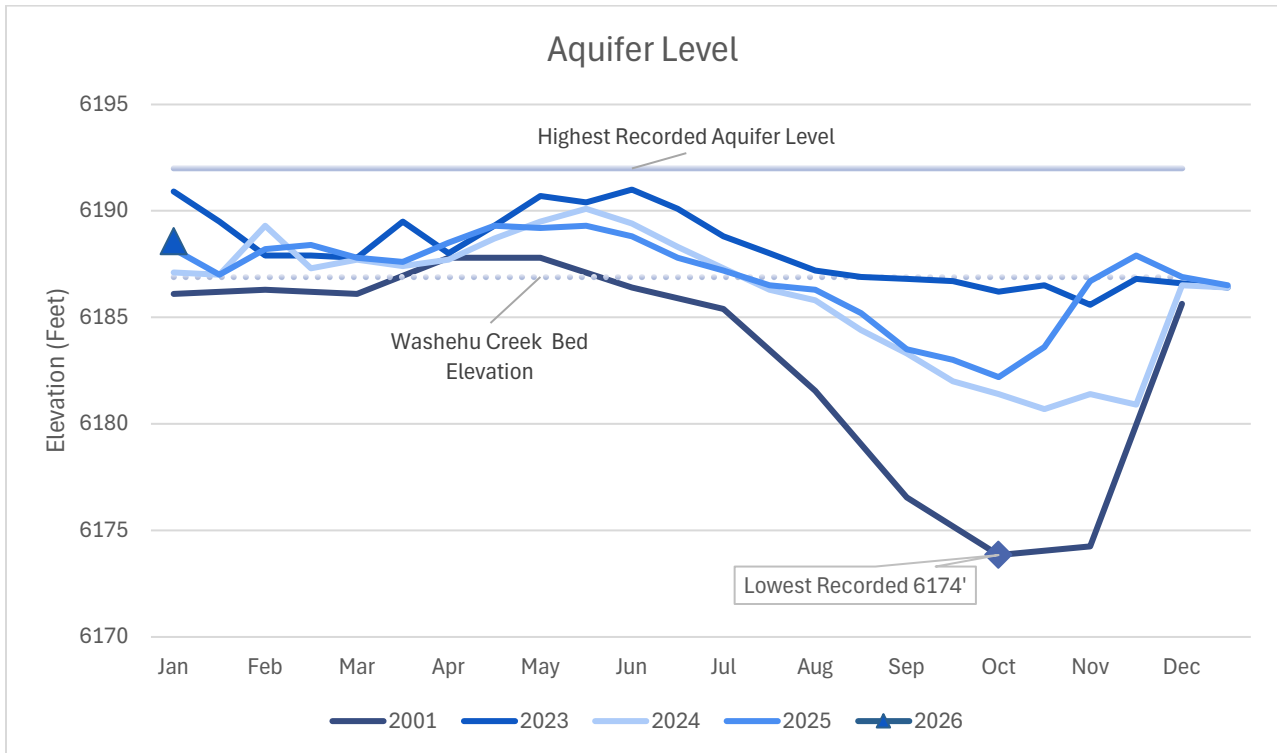

Precipitation:	December 2025:	21.67"
	Season to date total:	32.62"
	Season to date average:	20.07"
	% to year to date average:	162.53%

Flow Report Notes:

- The *Highest Recorded Aquifer Level* represents a rough average of the highest levels measured in the aquifer during spring melt period.
- The *Lowest Recorded Aquifer Level* is the lowest level recorded in the aquifer at 6,174.0 feet above mean sea level on October 5, 2001. This level is not necessarily indicative of the total capacity of the aquifer.
- The *Creek Bed Elevation* (per Kenneth Loy, West Yost Associates) near Well 2 is 6,186.9 feet.
- *Precipitation Season Total* is calculated from October 2025 through September 2026.
- The true *Season to date Average* could be higher or lower than the reported value due to the uncertainty of the Old Fire Station precipitation measurement during the period 1994 to 2004.
- In October 2011 the data acquisition point for the aquifer was changed from Well 2 to Well 2R.

Leaks and Repairs

Water

- The District issued zero leak/high usage notifications.
- Responded to one after-hours customer service calls.

Sewer

- Responded to one after-hours customer service calls.

Vehicles and Equipment

Vehicles

- Cleaned vehicles and checked inventory.

Equipment

- Cleaned equipment.

Operations and Maintenance Projects

1810 Olympic Valley Road (Old Fire Station)

- Inspected and tested the generator.
- General housekeeping.

305 Olympic Valley Road (Administration and Fire Station Building)

- Inspected and tested the generator.

#### Water System Maintenance

- Three bacteriological tests were taken in September: one at 1810 Olympic Valley Road, one at Everline Resort and one at Zone 3 Booster Station; All three samples were reported absent.
- Leak detection services performed: Two.
- Customer service turn water service on: One.
- Customer service turn water service off: One.
- Responded to customer service calls with no water: Zero
- Water meter upgrades: Ten

#### Sewer System Maintenance

- Check for I and I issues.
- Sewer cleaning.

#### Telemetry

- The rainfall measurements for the month of December were as follows:  
Nova Lynx: 21.67", Palisades Tahoe Snotel: 15.1".

#### Administration

- Monthly California State Water Boards report.

#### Services Rendered

- Underground Service Alerts (20)
- Sewer service line inspections (1)
- Sewer service line pressure tests (8)
- Water service line inspections (1)
- Water and Sewer Final Inspection (1)
- Water quality complaint investigations (0)

#### Other Items of Interest

- Service line leaks repaired on Sierra Crest Trail and Rock Garden Ct.
- Well 1 Overcurrent VFD Fault Christmas Eve, currently working with Carson Pump and San Joaquin Electric to diagnose the issue.

**ATTACHMENTS:** Monthly Water Audit Report

**DATE PREPARED:** January 21, 2026

# Olympic Valley Public Service District - Monthly Water Audit Report

Audit Month: December Report Date: January 16, 2025 Performed By: Nicolas Massetani  
Year: 2025  
Meter Reader: Jason McGathey Reading begin Date & Time: 12/29/25 12:00 AM  
Reading end Date & Time: 12/31/25 12:00 AM  
Total lag time: 48:00:00  
Begin Audit Period: 12/2/25 12:00 AM  
End Audit Period: 12/31/25 12:00 AM

---

Total Metered Consumption for audit period specified (including hydrant meters): 3,858,823

Additional Consumption - Unmetered

Fire Department Use: 5,000  
Hydrant Flushing: 10,000  
Blow-Off Flushing: \_\_\_\_\_  
Sewer Cleaning: \_\_\_\_\_  
Street Cleaning: \_\_\_\_\_  
Well Flushing: \_\_\_\_\_  
Tank Overflows: \_\_\_\_\_  
Unread Meter Estimated Reads: 41,655  
Other: \_\_\_\_\_  
Total Unmetered Consumption (for audit period specified): 56,655

Estimated Unknown Loss - Unmetered

Known Theft: \_\_\_\_\_  
Known Illegal Connections: \_\_\_\_\_  
Total Estimated leaks that have been repaired: 57,600  
Total Estimated Unmetered (for audit period specified): 57,600

---

Total Production for audit period specified: 5,683,081

Total Metered/Unmetered Consumption for audit period specified: 3,973,078

**Total Water Loss (Production - Consumption): 1,710,003**

---

**Comments:** The production totals differ from the monthly report due to a different time frame being used. Additionally, multiple commercial meters were installed in November for several of our high-use customers. There is typically a delay before their meter reads are fully uploaded into the system. Leak repaired on service line on Sierra Crest Trail ~5GPM.

---

---

\* Note - All Production & Consumption Totals In U.S. Gallons \*