



OLYMPIC VALLEY PUBLIC SERVICE DISTRICT BOARD REPORT




SUBJECT: February Water & Sewer Operations Report **EXHIBIT:** G-2, 5 Pages
AUTHOR: Nicolas Massetani, Operations Superintendent **MEETING DATE:** March 31, 2026

RECOMMENDED ACTION: This report is informational only; no action is requested from the Board.

DISCUSSION: This report provides information from the District’s management on current projects and activities that are not the subject of a separate report. This report is prepared to provide new information and recent progress only.


Flow Report – February 2026

Water Production: 6.44 MG
Comparison: 0.01 MG less than 2025

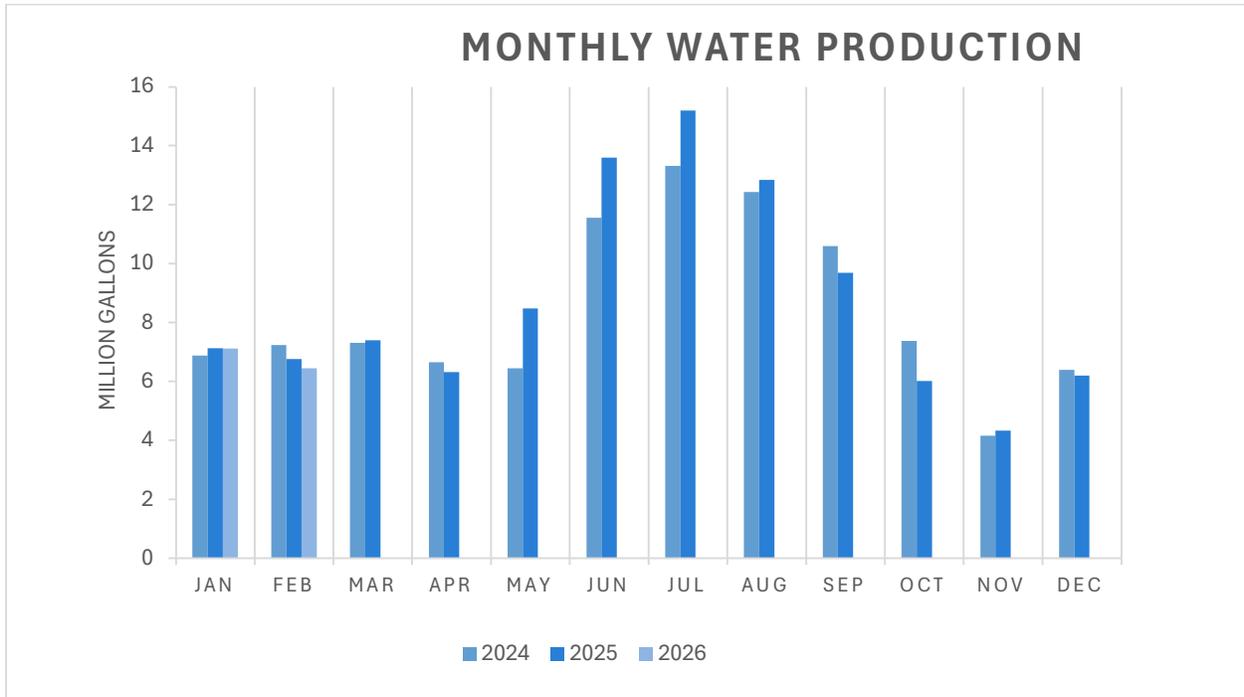

Sewer Collection:
Comparison:


10.31 MG
4.58 MG less than 2025

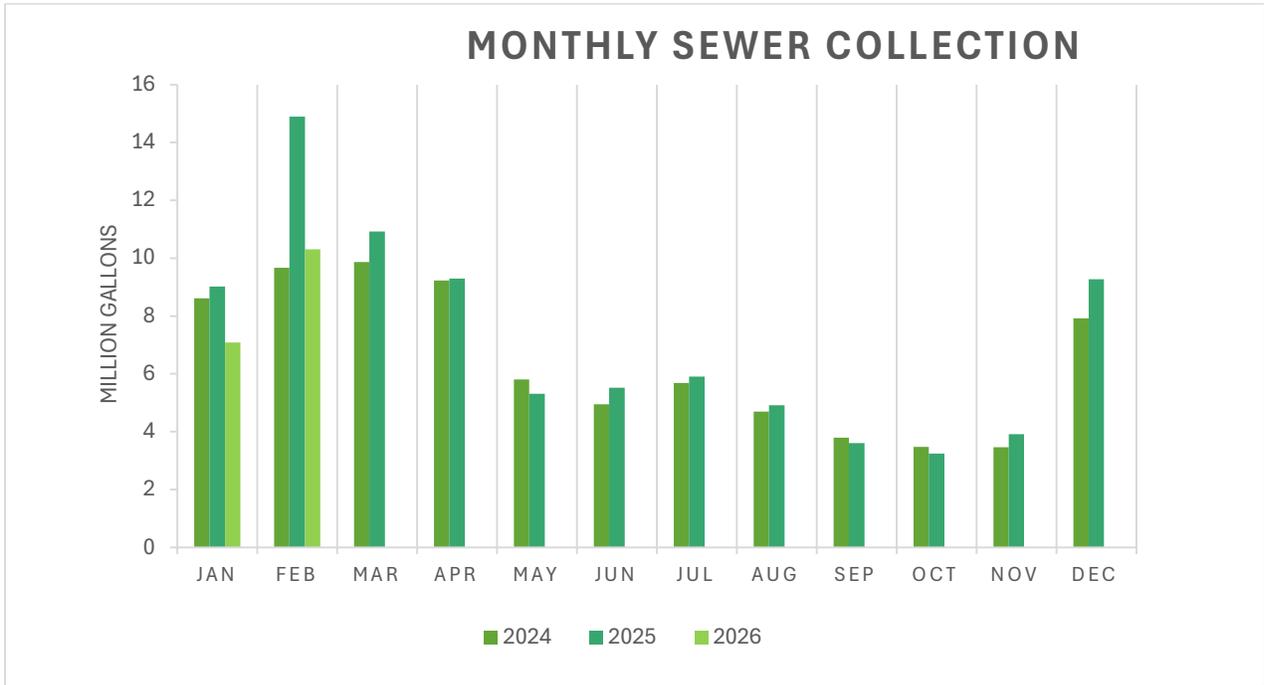

Aquifer Level:

February 31, 2026:
February 31, 2025:

6,189.4'
6,187.8'

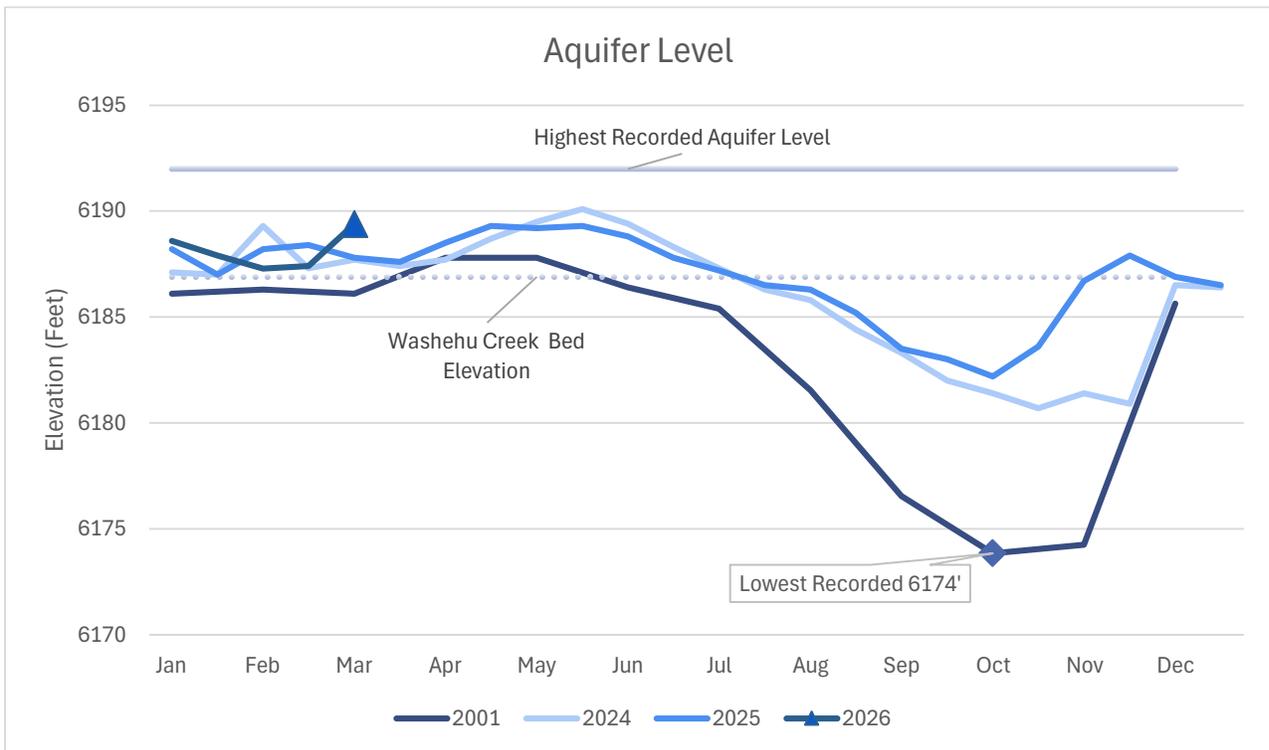

| | | |
|----------------|----------------------------|---------|
| Precipitation: | February 2026: | 10.13" |
| | Season to date total: | 48.67" |
| | Season to date average: | 37.54" |
| | % to year to date average: | 129.63% |

Flow Report Notes:

- The *Highest Recorded Aquifer Level* represents a rough average of the highest levels measured in the aquifer during spring melt period.
- The *Lowest Recorded Aquifer Level* is the lowest level recorded in the aquifer at 6,174.0 feet above mean sea level on October 5, 2001. This level is not necessarily indicative of the total capacity of the aquifer.
- The *Creek Bed Elevation* (per Kenneth Loy, West Yost Associates) near Well 2 is 6,186.9 feet.
- *Precipitation Season Total* is calculated from October 2025 through September 2026.
- The true *Season to date Average* could be higher or lower than the reported value due to the uncertainty of the Old Fire Station precipitation measurement during the period 1994 to 2004.
- In October 2011 the data acquisition point for the aquifer was changed from Well 2 to Well 2R.

Leaks and Repairs

Water

- The District issued two leak/high usage notifications.
- Responded to two after-hours customer service calls.

Sewer

- Responded to zero after-hours customer service calls.

Vehicles and Equipment

Vehicles

- Cleaned vehicles and checked inventory.

Equipment

- Cleaned equipment.

Operations and Maintenance Projects

1810 Olympic Valley Road (Old Fire Station)

- Inspected and tested the generator.
- General housekeeping.

305 Olympic Valley Road (Administration and Fire Station Building)

- Inspected and tested the generator.

Water System Maintenance

- Three bacteriological tests were taken in February: one at 1810 Olympic Valley Road, one at Everline Resort and one at Zone 3 Booster Station; All three samples were reported absent.
- Leak detection services performed: Two.
- Customer service turn water service on: Zero
- Customer service turn water service off: One.
- Responded to customer service calls with no water: One
- Water meter upgrades: One

Sewer System Maintenance

- Check for I and I issues.
- Sewer cleaning.

Telemetry

- The rainfall measurements for the month of December were as follows:
Nova Lynx: 10.13", Palisades Tahoe Snotel: 10.3".

Administration

- Monthly California State Water Boards report.
- 2025 CIWQS Annual Report submitted.
- 2025 Placer County Air Quality Throughputs submitted.
- 2025 DOORS eROAR Submitted.
- 2025 DTSC eVQ Submitted.

Services Rendered

- Underground Service Alerts (1)
- Sewer service line inspections (0)
- Sewer service line pressure tests (0)
- Water service line inspections (0)
- Water and Sewer Final Inspection (0)
- Water quality complaint investigations (0)

ATTACHMENTS: Monthly Water Audit Report

DATE PREPARED: March 23, 2026

Olympic Valley Public Service District - Monthly Water Audit Report

Audit Month: February Report Date: March 23, 2026 Performed By: Nicolas Massetani
Year: 2026

Meter Reader: Ben Procida Reading begin Date & Time: 3/4/26 8:30 AM
Reading end Date & Time: 3/4/26 11:30 AM
Total lag time: 3 Hours

Begin Audit Period: 2/4/26 12:00 AM
End Audit Period: 3/4/26 12:00 AM

Total Metered Consumption for audit period specified (including hydrant meters): 6,443,371

Additional Consumption - Unmetered

Fire Department Use: 5,000

Hydrant Flushing: _____

Blow-Off Flushing: _____

Sewer Cleaning: _____

Street Cleaning: _____

Well Flushing: _____

Tank Overflows: _____

Unread Meter Estimated Reads: _____

Other: _____

Total Unmetered Consumption (for audit period specified): 5,000

Estimated Unknown Loss - Unmetered

Known Theft: _____

Known Illegal Connections: _____

Total Estimated leaks that have been repaired: _____

Total Estimated Unmetered (for audit period specified): _____

Total Production for audit period specified: 6,478,035

Total Metered/Unmetered Consumption for audit period specified: 6,448,371

Total Water Loss (Production - Consumption): 29,664

Comments: The production totals are different than the monthly report due to a different time frame being used.

* Note - All Production & Consumption Totals In U.S. Gallons *