



OLYMPIC VALLEY PUBLIC SERVICE DISTRICT BOARD REPORT



SUBJECT: April Water & Sewer Operations Report

EXHIBIT: G-2, 5 Pages

AUTHOR: Nicolas Massetani, Operations Superintendent

MEETING DATE: May 26, 2026

RECOMMENDED ACTION: This report is informational only; no action is requested from the Board.

DISCUSSION: This report provides information from the District’s management on current projects and activities that are not the subject of a separate report. This report is prepared to provide new information and recent progress only.


Flow Report – April 2026

Water Production:

4.98 MG


Comparison:

1.34 MG less than 2025

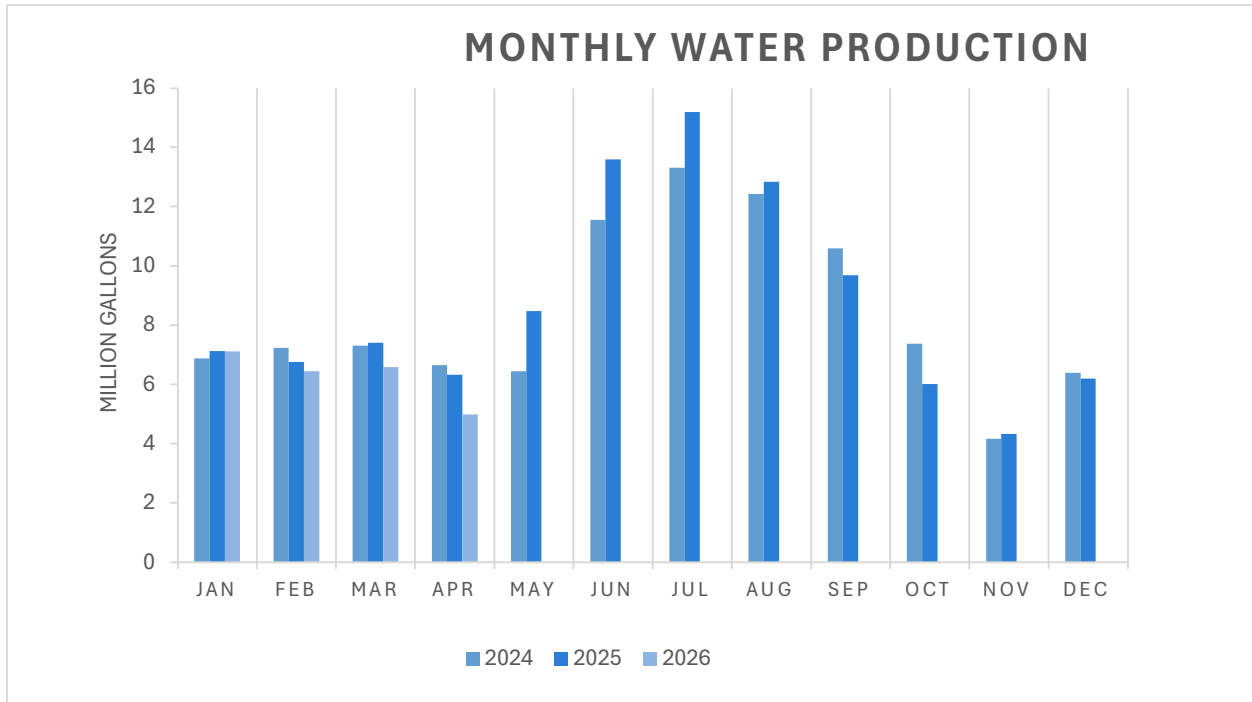

Sewer Collection:
Comparison:


7.71 MG
1.58 MG less than 2025

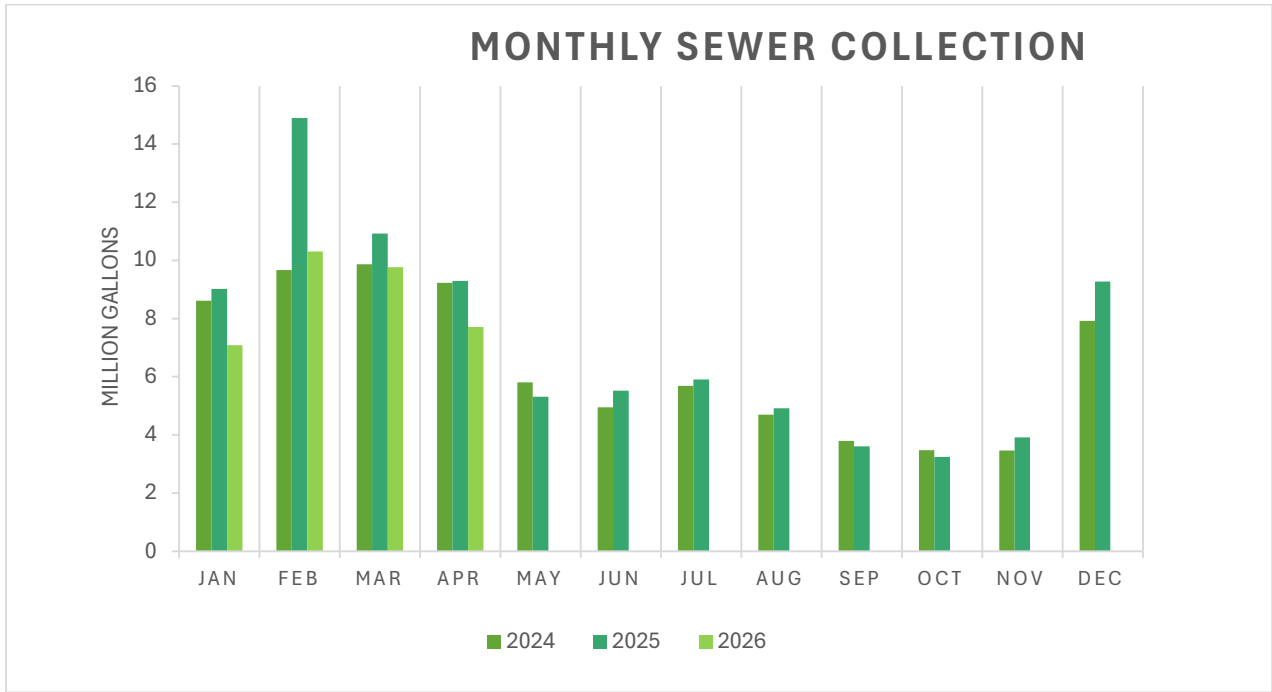

Aquifer Level:

April 31, 2026:
April 31, 2025:

6,188.7'
6,189.2'

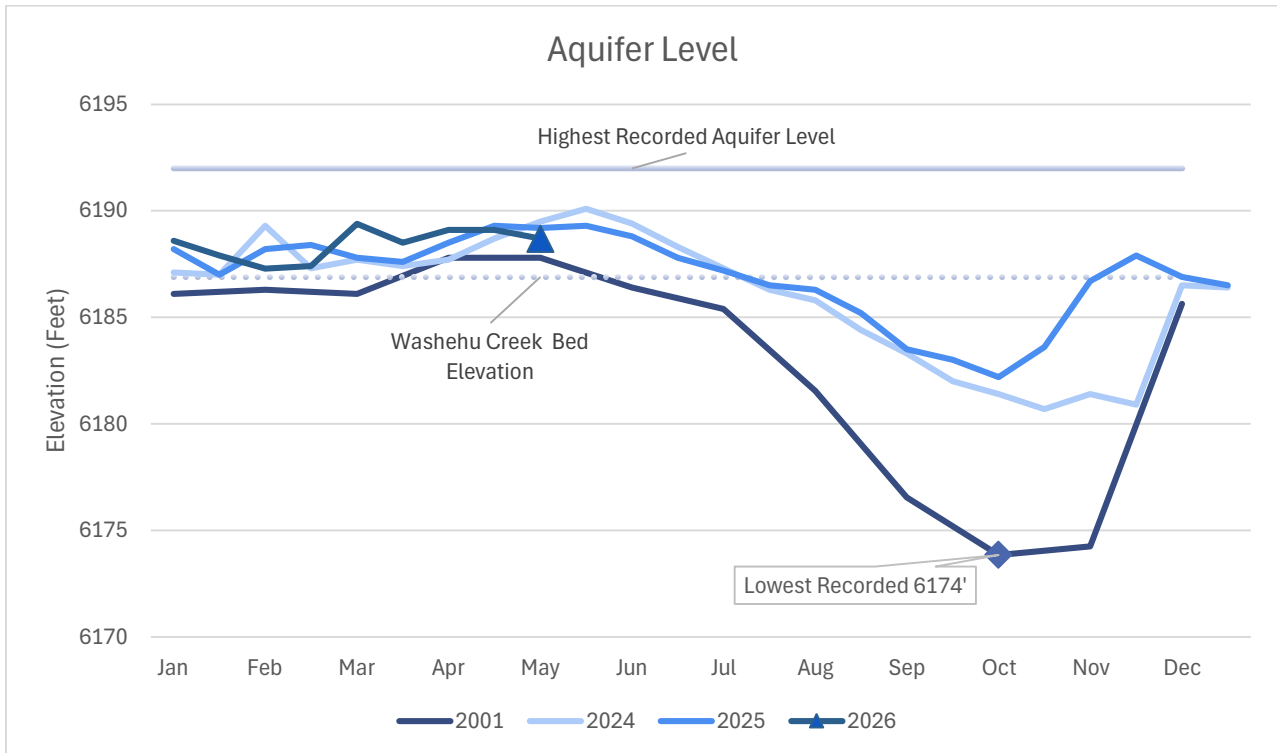

Precipitation:	April 2026:	8.41"
	Season to date total:	60.01"
	Season to date average:	48.74"
	% to year to date average:	123.13%

Flow Report Notes:

- The *Highest Recorded Aquifer Level* represents a rough average of the highest levels measured in the aquifer during spring melt period.
- The *Lowest Recorded Aquifer Level* is the lowest level recorded in the aquifer at 6,174.0 feet above mean sea level on October 5, 2001. This level is not necessarily indicative of the total capacity of the aquifer.
- The *Creek Bed Elevation* (per Kenneth Loy, West Yost Associates) near Well 2 is 6,186.9 feet.
- *Precipitation Season Total* is calculated from October 2025 through September 2026.
- The true *Season to date Average* could be higher or lower than the reported value due to the uncertainty of the Old Fire Station precipitation measurement during the period 1994 to 2004.
- In October 2011 the data acquisition point for the aquifer was changed from Well 2 to Well 2R.

Leaks and Repairs

Water

- The District issued four leak/high usage notifications.
- Responded to two after-hours customer service calls.

Sewer

- Responded to zero after-hours customer service calls.

Vehicles and Equipment

Vehicles

- Cleaned vehicles and checked inventory.

Equipment

- Cleaned equipment.

Operations and Maintenance Projects

1810 Olympic Valley Road (Old Fire Station)

- Inspected and tested the generator.
- General housekeeping.

305 Olympic Valley Road (Administration and Fire Station Building)

- Inspected and tested the generator.

Water System Maintenance

- Three bacteriological tests were taken in March: one at 1810 Olympic Valley Road, one at Everline Resort and one at Zone 3 Booster Station; All three samples were reported absent.
- Leak detection services performed: Three
- Customer service turn water service on: Zero
- Customer service turn water service off: Zero
- Responded to customer service calls with no water: Zero
- Water meter upgrades: Zero

Sewer System Maintenance

- Check for I and I issues.
- Sewer cleaning.

Telemetry

- The rainfall measurements for the month of April were as follows:
Nova Lynx: 8.41", Palisades Tahoe Snotel: 7.9".

Administration

- Monthly California State Water Boards report.
- 2025 Water & Sewer System Report.
- Backflow Testing Notices – Transition to Syncta
The District contracted with Syncta to manage the cross-connection control program and annual backflow testing notifications. Engineering, Operations, and Administration staff compiled customer and backflow device data for integration into the new platform. The system will store device records, generate annual customer notification letters, and require electronic submission of test reports by certified testers. Operations staff will review all submitted test reports for compliance with California and District requirements. The first notification letters are scheduled to be sent via email or USPS in June.

Services Rendered

- Underground Service Alerts (3)
- Sewer service line inspections (0)
- Sewer service line pressure tests (1)
- Water service line inspections (0)
- Water and Sewer Final Inspection (1)
- Water quality complaint investigations (0)

ATTACHMENTS: Monthly Water Audit Report

DATE PREPARED: May 18, 2026

Olympic Valley Public Service District - Monthly Water Audit Report

Audit Month: April Report Date: May 19, 2026 Performed By: Nic Massetani
Year: 2026

Meter Reader: Ben Procida Reading begin Date & Time: 5/1/26 8:30 AM
Reading end Date & Time: 5/1/26 12:00 PM
Total lag time: 3.5 hours

Begin Audit Period: 4/1/26 12:00 AM
End Audit Period: 5/1/26 12:00 AM

Total Metered Consumption for audit period specified (including hydrant meters): 4,804,099

Additional Consumption - Unmetered

Fire Department Use: 5,000
Hydrant Flushing: 14,000
Blow-Off Flushing: _____
Sewer Cleaning: _____
Street Cleaning: _____
Well Flushing: _____
Tank Overflows: _____
Unread Meter Estimated Reads: _____
Other: _____

Total Unmetered Consumption (for audit period specified): 19,000

Estimated Unknown Loss - Unmetered

Known Theft: _____
Known Illegal Connections: _____
Total Estimated leaks that have been repaired: _____
Total Estimated Unmetered (for audit period specified): _____

Total Production for audit period specified: 4,984,530

Total Metered/Unmetered Consumption for audit period specified: 4,823,099

Total Water Loss (Production - Consumption): 161,431

Comments: The production totals are different than the monthly report due to a different time frame being used. The District continues to search for leaks.

* Note - All Production & Consumption Totals In U.S. Gallons *