



OLYMPIC VALLEY PUBLIC SERVICE DISTRICT BOARD REPORT



SUBJECT: July Water & Sewer Operations Report

EXHIBIT: G-2, 5 Pages

AUTHOR: Nicolas Massetani, Operations Superintendent

MEETING DATE: August 25,
2026

RECOMMENDED ACTION: This report is informational only; no action is requested from the Board.

DISCUSSION: This report provides information from the District's management on current projects and activities that are not the subject of a separate report. This report is prepared to provide new information and recent progress only.


Flow Report – July 2026

Water Production:

12.79 MG


Comparison:

2.4 MG less than 2025

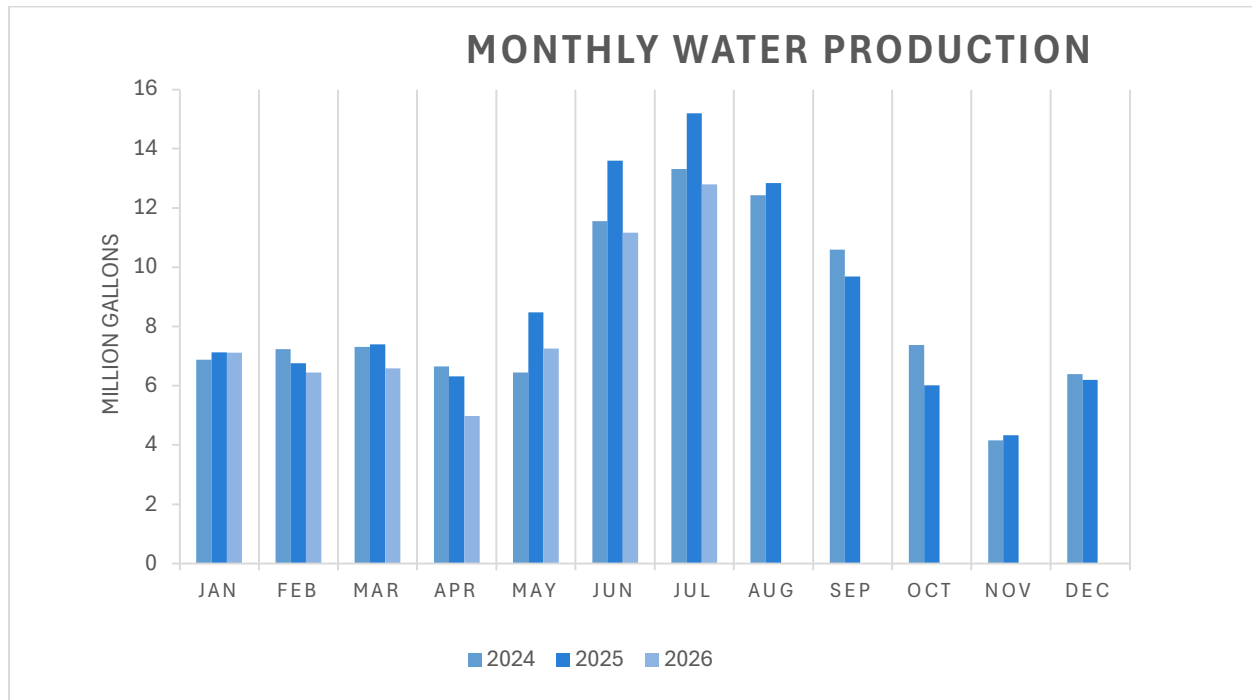

Sewer Collection:
Comparison:


4.78 MG
0.27 MG more than 2025

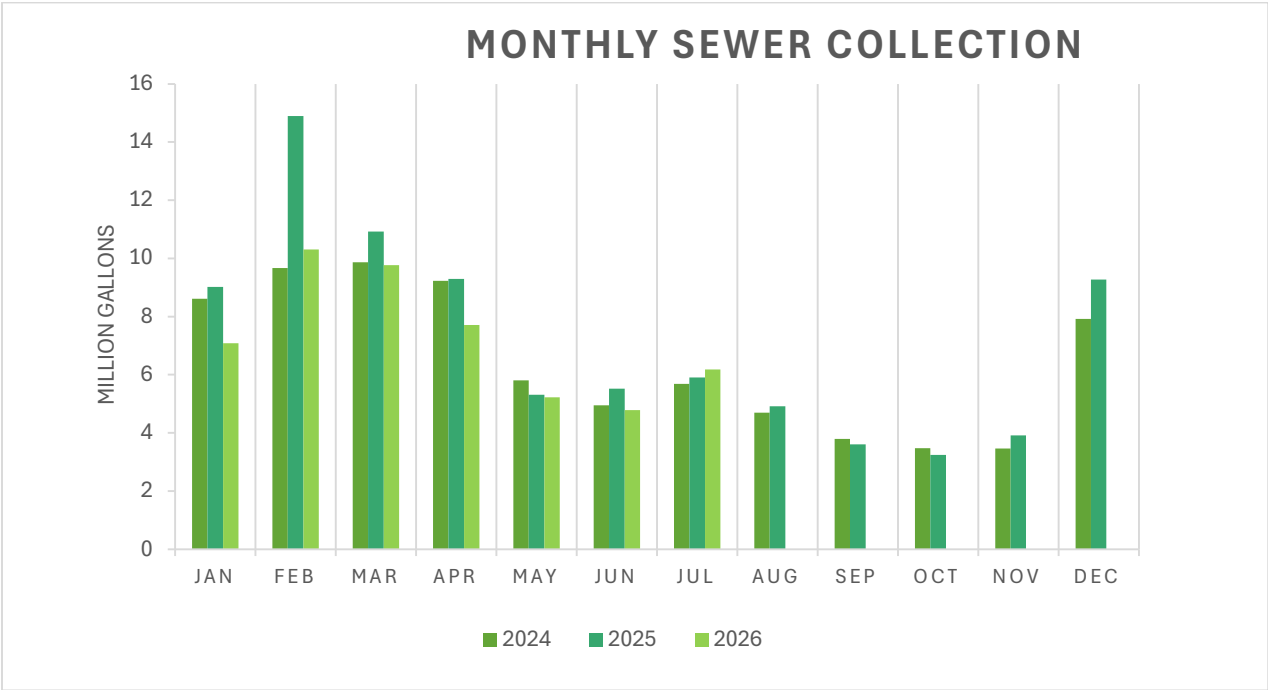

Aquifer Level:

July 31, 2026:
July 31, 2025:

6,183.2'
6,186.3'

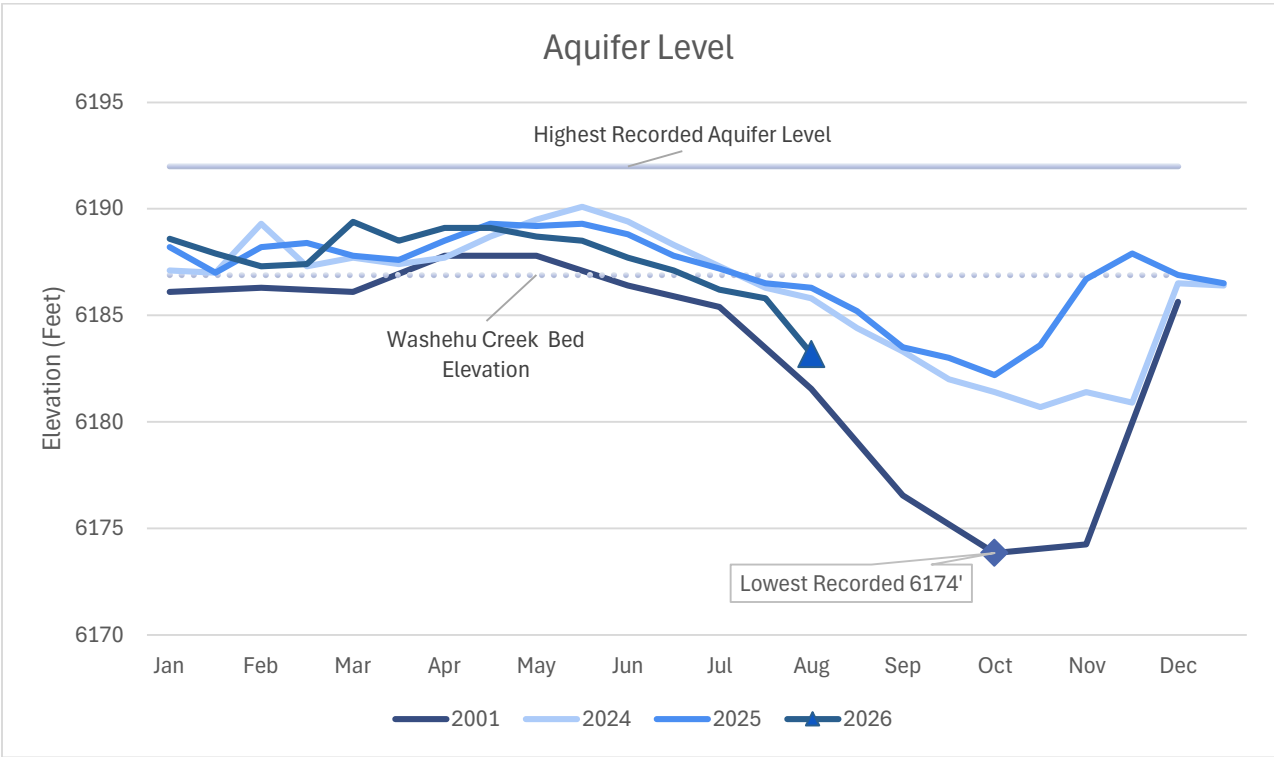

Precipitation:	July 2026:	0.8"
	Season to date total:	63.54"
	Season to date average:	52.01"
	% to year to date average:	122.18%

Flow Report Notes:

- The *Highest Recorded Aquifer Level* represents a rough average of the highest levels measured in the aquifer during spring melt period.
- The *Lowest Recorded Aquifer Level* is the lowest level recorded in the aquifer at 6,174.0 feet above mean sea level on October 5, 2001. This level is not necessarily indicative of the total capacity of the aquifer.
- The *Creek Bed Elevation* (per Kenneth Loy, West Yost Associates) near Well 2 is 6,186.9 feet.
- *Precipitation Season Total* is calculated from October 2025 through September 2026.
- The true *Season to date Average* could be higher or lower than the reported value due to the uncertainty of the Old Fire Station precipitation measurement during the period 1994 to 2004.
- In October 2011 the data acquisition point for the aquifer was changed from Well 2 to Well 2R.

Leaks and Repairs

Water

- The District issued five leak/high usage notifications.
- Responded to one after-hours customer service call.

Sewer

- Responded to zero after-hours customer service calls.

Vehicles and Equipment

Vehicles

- Cleaned vehicles and checked inventory.

Equipment

- Cleaned equipment.

Operations and Maintenance Projects

1810 Olympic Valley Road (Old Fire Station)

- Inspected and tested the generator.
- General housekeeping.

305 Olympic Valley Road (Administration and Fire Station Building)

- Inspected and tested the generator.

Water System Maintenance

- Three bacteriological tests were taken in June: one at 1810 Olympic Valley Road, one at Everline Resort and one at Zone 3 Booster Station; All three samples were reported absent.
- Leak detection services performed: Three
- Customer service turn water service on: Zero
- Customer service turn water service off: Zero
- Responded to customer service calls with no water: Zero

Sewer System Maintenance

- Check for I and I issues.
- Sewer cleaning.

Telemetry

- The rainfall measurements for the month of June were as follows: Nova Lynx: 0.8", Palisades Tahoe Snotel: 0.5".

Administration

- Monthly California State Water Boards report.
- Backflow testing report management- Syncta

Services Rendered

- Underground Service Alerts (46)
- Sewer service line inspections (0)
- Sewer service line pressure tests (6)
- Water service line inspections (0)
- Water and Sewer Final Inspections (1)
- Water quality complaint investigations (0)

ATTACHMENTS: Monthly Water Audit Report

DATE PREPARED: August 18, 2026

Olympic Valley Public Service District - Monthly Water Audit Report

Audit Month: July
Year: 2026

Report Date: August 19, 2026

Performed By: Nicolas Massetani

Meter Reader: John Tuscher

Reading begin Date & Time: 7/31/26 8:30 AM

Reading end Date & Time: 7/31/26 11:30 AM

Total lag time: 3:00:00

Begin Audit Period: 7/2/26 12:00 AM

End Audit Period: 7/31/26 12:00 AM

Total Metered Consumption for audit period specified (including hydrant meters): 11,214,051

Additional Consumption - Unmetered

Fire Department Use: 10,000

Hydrant Flushing: _____

Blow-Off Flushing: _____

Sewer Cleaning: 4,800

Street Cleaning: _____

Well Flushing: _____

Tank Overflows: _____

Unread Meter Estimated Reads: _____

Other: _____

Total Unmetered Consumption (for audit period specified): 14,800

Estimated Unknown Loss - Unmetered

Known Theft: _____

Known Illegal Connections: _____

Total Estimated leaks that have been repaired: _____

Total Estimated Unmetered (for audit period specified): _____

Total Production for audit period specified: 12,067,086

Total Metered/Unmetered Consumption for audit period specified: 11,228,851

Total Water Loss (Production - Consumption): 838,235

Comments: The production totals are different than the monthly report due to a different time frame being used.

* Instructions - Only fill in the blue cells *

* Note - All Production & Consumption Totals In U.S. Gallons *

*** Note - Total Water Loss Percentage including theft, Illegal Connections or Leaks that have been repaired