OLYMPIC VALLEY
PUBLIC SERVICE DISTRICT
BOARD REPORT


SUBJECT:	September Water & Sewer Operations Report	**EXHIBIT:**	G-2, 5 Pages
AUTHOR:	John Tuscher, Interim Operations Superintendent	**MEETING DATE:**	November 17, 2026

RECOMMENDED ACTION: This report is informational only; no action is requested from the Board.


DISCUSSION: This report provides information from the District's management on current projects and activities that are not the subject of a separate report. This report is prepared to provide new information and recent progress only.

Flow Report – October 2026


Water Production:	6.44 MG
Comparison:	0.43 MG ***more*** than 2025

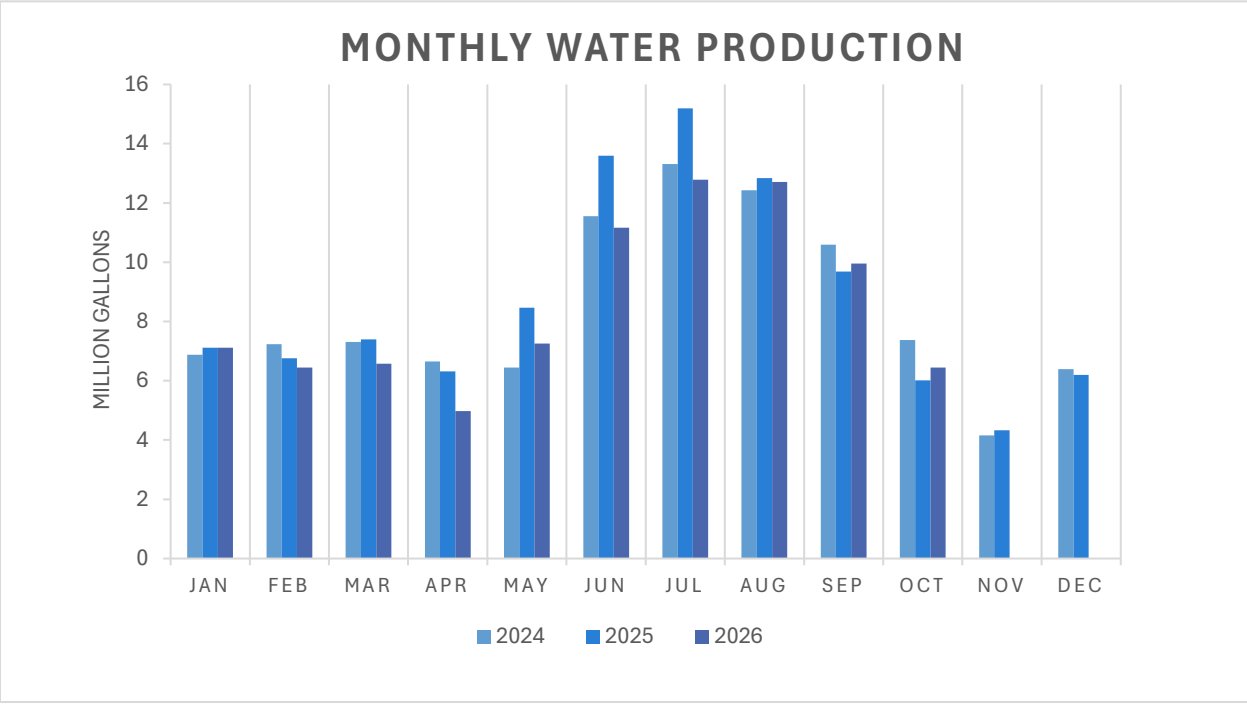

Sewer Collection:	3.91 MG
Comparison:	0.09 MG ***less*** than 2025

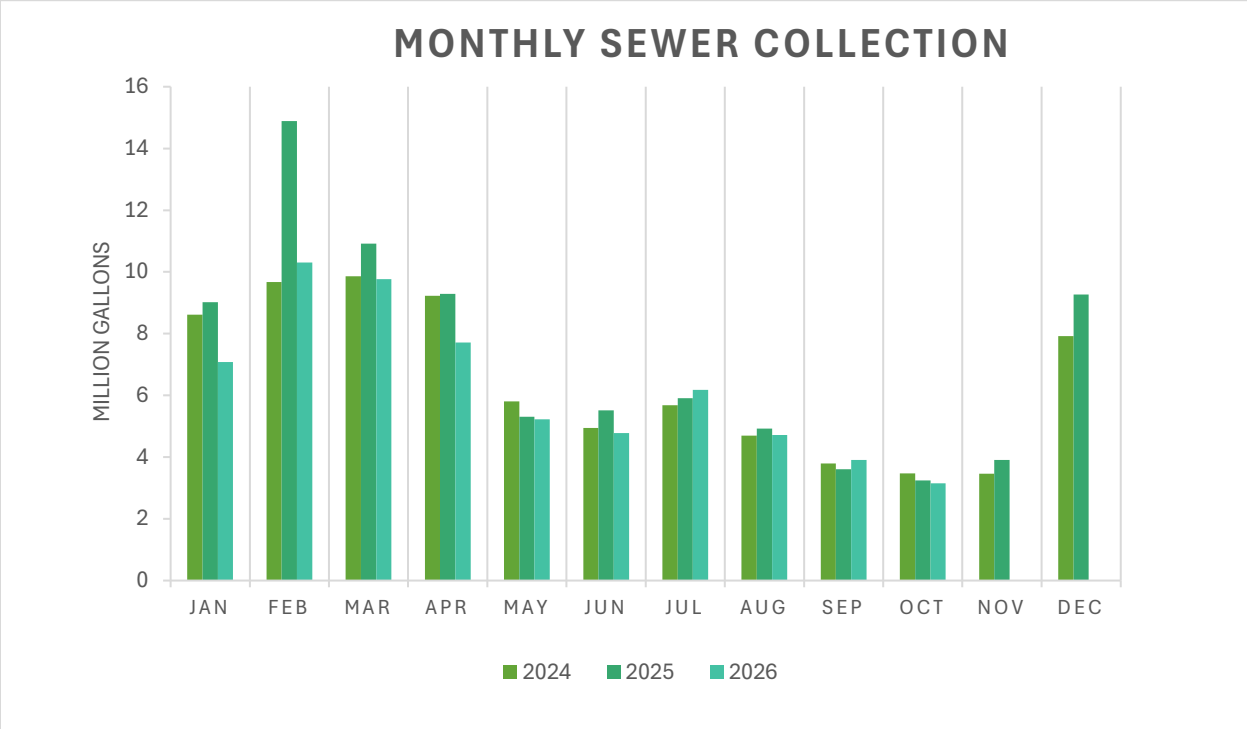

Aquifer Level:	November 1, 2026:	6,179.7'
	November 1, 2025:	6,186.7'

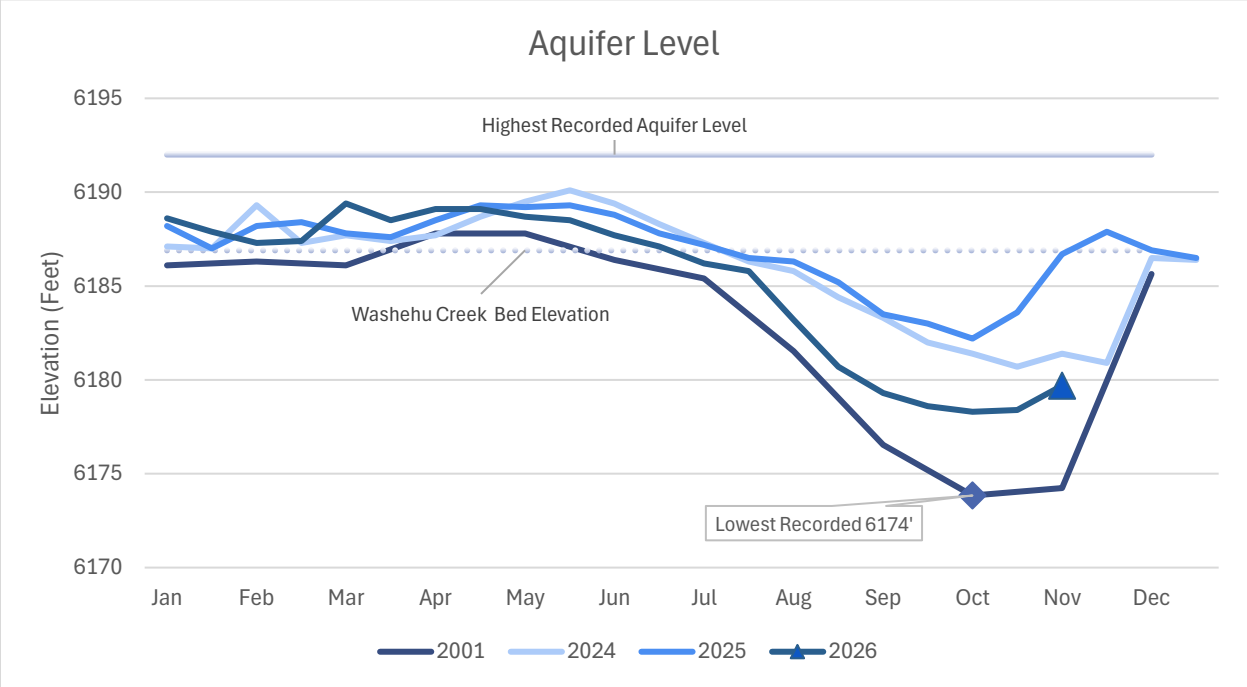

Precipitation:	October 2026:	1.97”
	Season to date total:	1.97”
	Season to date average:	3.21”
	% to year to date average:	61.35%

Flow Report Notes:

- The *Highest Recorded Aquifer Level* represents a rough average of the highest levels measured in the aquifer during spring melt period.
- The *Lowest Recorded Aquifer Level* is the lowest level recorded in the aquifer at 6,174.0 feet above mean sea level on October 5, 2001. This level is not necessarily indicative of the total capacity of the aquifer.
- The *Creek Bed Elevation* (per Kenneth Loy, West Yost Associates) near Well 2 is 6,186.9 feet.
- *Precipitation Season Total* is calculated from October 2025 through September 2026.
- The true *Season-to-date Average* could be higher or lower than the reported value due to the uncertainty of the Old Fire Station precipitation measurement during the period 1994 to 2004.
- In October 2011 the data acquisition point for the aquifer was changed from Well 2 to Well 2R.

Leaks and Repairs

Water

- The District issued no leak/high usage notifications.
- Responded to no after-hours customer service call.

Sewer

- Responded to zero after-hours customer service calls.

Vehicles and Equipment

Vehicles

- Cleaned vehicles and checked inventory.

Equipment

- Cleaned equipment.

Operations and Maintenance Projects

1810 Olympic Valley Road (Old Fire Station)

- Inspected and tested the generator.
- General housekeeping.

305 Olympic Valley Road (Administration and Fire Station Building)

- Inspected and tested the generator.

Water System Maintenance

- Three bacteriological tests were taken in August: one at 1810 Olympic Valley Road, one at Everline Resort and one at Zone 3 Booster Station; All three samples were reported absent.
- Leak detection services performed: Zero
- Customer service turn water service on: Zero
- Customer service turn water service off: Zero
- Responded to customer service calls with no water: Zero

Sewer System Maintenance

- Check for I and I issues.
- Sewer cleaning.
- Support Sewer Rehabilitation project.

Telemetry

- The rainfall measurements for the month of August were as follows: Nova Lynx: 1.97", Palisades Tahoe Snotel: 2.4"

Administration

- Monthly California State Water Boards report.
- Backflow testing report management- Syncta

Services Rendered

- Underground Service Alerts (13)
- Sewer service line inspections (0)
- Sewer service line pressure tests (0)
- Water service line inspections (1)
- Water and Sewer Final Inspections (0)
- Water quality complaint investigations (0)

ATTACHMENTS: Monthly Water Audit Report

DATE PREPARED: November 12, 2026

Olympic Valley Public Service District - Monthly Water Audit Report

Audit Month: October
Year: 2026
Report Date: November 12, 2026
Performed By: John Tuscher

Meter Reader: Jason McGathey
Reading begin Date & Time: 11/3/26 8:30 AM
Reading end Date & Time: 11/3/26 9:30 AM
Total lag time: 1:00:00

Begin Audit Period: 10/1/26 12:00 AM
End Audit Period: 11/3/26 12:00 AM

Total Metered Consumption for audit period specified (including hydrant meters): 6,021,319

Additional Consumption - Unmetered

Fire Department Use:	5,000
Hydrant Flushing:	12,000
Blow-Off Flushing:	
Sewer Cleaning:	16,400
Street Cleaning:	
Well Flushing:	
Tank Overflows:	
Unread Meter Estimated Reads:	
Other:	
Total Unmetered Consumption (for audit period specified):	33,400

Estimated Unknown Loss - Unmetered

Known Theft:	
Known Illegal Connections:	
Total Estimated leaks that have been repaired:	
Total Estimated Unmetered (for audit period specified):	

Total Production for audit period specified: 6,679,204

Total Metered/Unmetered Consumption for audit period specified: 6,054,719

Total Water Loss (Production - Consumption): 624,485

Comments: The production totals are different than the monthly report due to a different time frame being used.
The District continues to investigate leaks.

* Note - All Production & Consumption Totals In U.S. Gallons *